




**CITY OF HENDERSON**  
 240 Water Street  
 P.O. Box 95050  
 Henderson, NV 89009  
 702-267-3610

# BUILDING & FIRE SAFETY

702-267-3650  
 Fax 702-267-3603

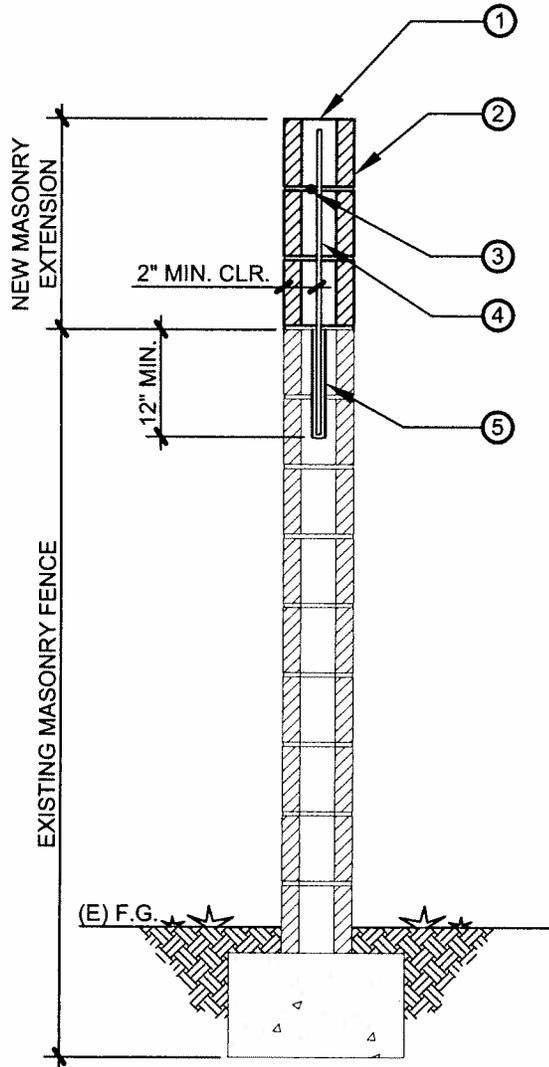

## SECTION

NTS

### GENERAL NOTES:

1. ALL WORK SHALL CONFORM TO THE 2006 IBC WITH SNA.
2. CONCRETE MASONRY SHALL COMPLY WITH THE FOLLOWING:
  - A. ASTM 55 OR C 90
  - B. MORTAR: TYPE M OR S, 1900 PSI
  - C. GROUT SHALL CONFORM TO ASTM C 476, 2000 PSI MIN.
3. ALL REINFORCING STEEL SHALL BE INTERMEDIATE GRADE ASTM A615-40.
4. MAXIMUM WALL HEIGHT FROM TOP OF FOOTING TO TOP OF WALL SHALL NOT BE GREATER THAN 6'-0" FOR 6" MASONRY OR 8'-0" FOR 8" MASONRY FENCE.
5. SITE PLAN SHALL BE SUBMITTED FOR REVIEW BEFORE THE BUILDING PERMIT CAN BE ISSUED.

### KEYNOTES: #

- ① - GROUT SOLID AT NEW REINFORCING CELL. FINISH TOP OF NEW MASONRY WALL WITH A CAP BLOCK OR PARGE WITH CONCRETE FOR WATER RUN-OFF.
- ② - NEW SOLID GROUTED BOND BEAM
- ③ - (1) #4 CONTINUOUS HORIZONTAL REBAR
- ④ - NEW #4 VERTICAL REBAR TO MATCH EXISTING SPACING
- ⑤ - DRILL, BRUSH AND BLOW NEW HOLE FOR VERTICAL REBAR. DOWEL IN ACCORDANCE WITH THE EPOXY LISTING. EPOXY SHALL BE KEPT ON-SITE DURING INSPECTION.

DRAWING NAME:

## MASONRY WALL EXTENSION ON EXISTING MASONRY WALL DETAIL

DRAWING NO.:

BFS-3

DATE:

AUGUST 2007