



OUR COMMUNITY



OUR FUTURE



AMENDED MAY 2020



COMPREHENSIVE PLAN
Appendices

Appendix M – Above Ground Utility Corridor Plan



ABOVE GROUND UTILITY CORRIDOR

- Transmission Lines (200KW or more)
- USGS Washes
- Designated City of Henderson Corridor
- Lake Las Vegas
- Railroad
- Corporate Limits

Adoption per City Council: December 2, 2014



Revised: December 2016

Source(s): City of Henderson Community Development & Services Department, Clark County Assessor's Office, Clark County Geographic Information Systems Management Office.


Based on Projected Coordinate System:
NAD83, StatePlane NV East FIPS 2701 Feet

Note: This map is offered as a general reference guide only. Neither warranty of accuracy is intended nor should any be assumed.



City of Henderson | 240 Water Street
P.O. Box 95050 | Henderson, NV 89009-5050
www.cityofhenderson.com | Tel. (702) 267-2323

As required by NRS 278.160(e)(3), the City of Henderson shall plan for the location of transmission lines designed and/or designated to operate at 200 kv or greater that is consistent with any Bureau of Land Management Resource Management Plan, any transmission plan prepared by the Office of Energy, and is coordinated with the plans of adjacent jurisdictions. Utility Providers will locate transmission lines within an established corridor, as depicted on the adopted Above Ground Utility Corridor Map, and in compliance with all zoning and permitting requirements, whenever technically feasible, and when it can be accomplished without undue impact on existing and planned development.

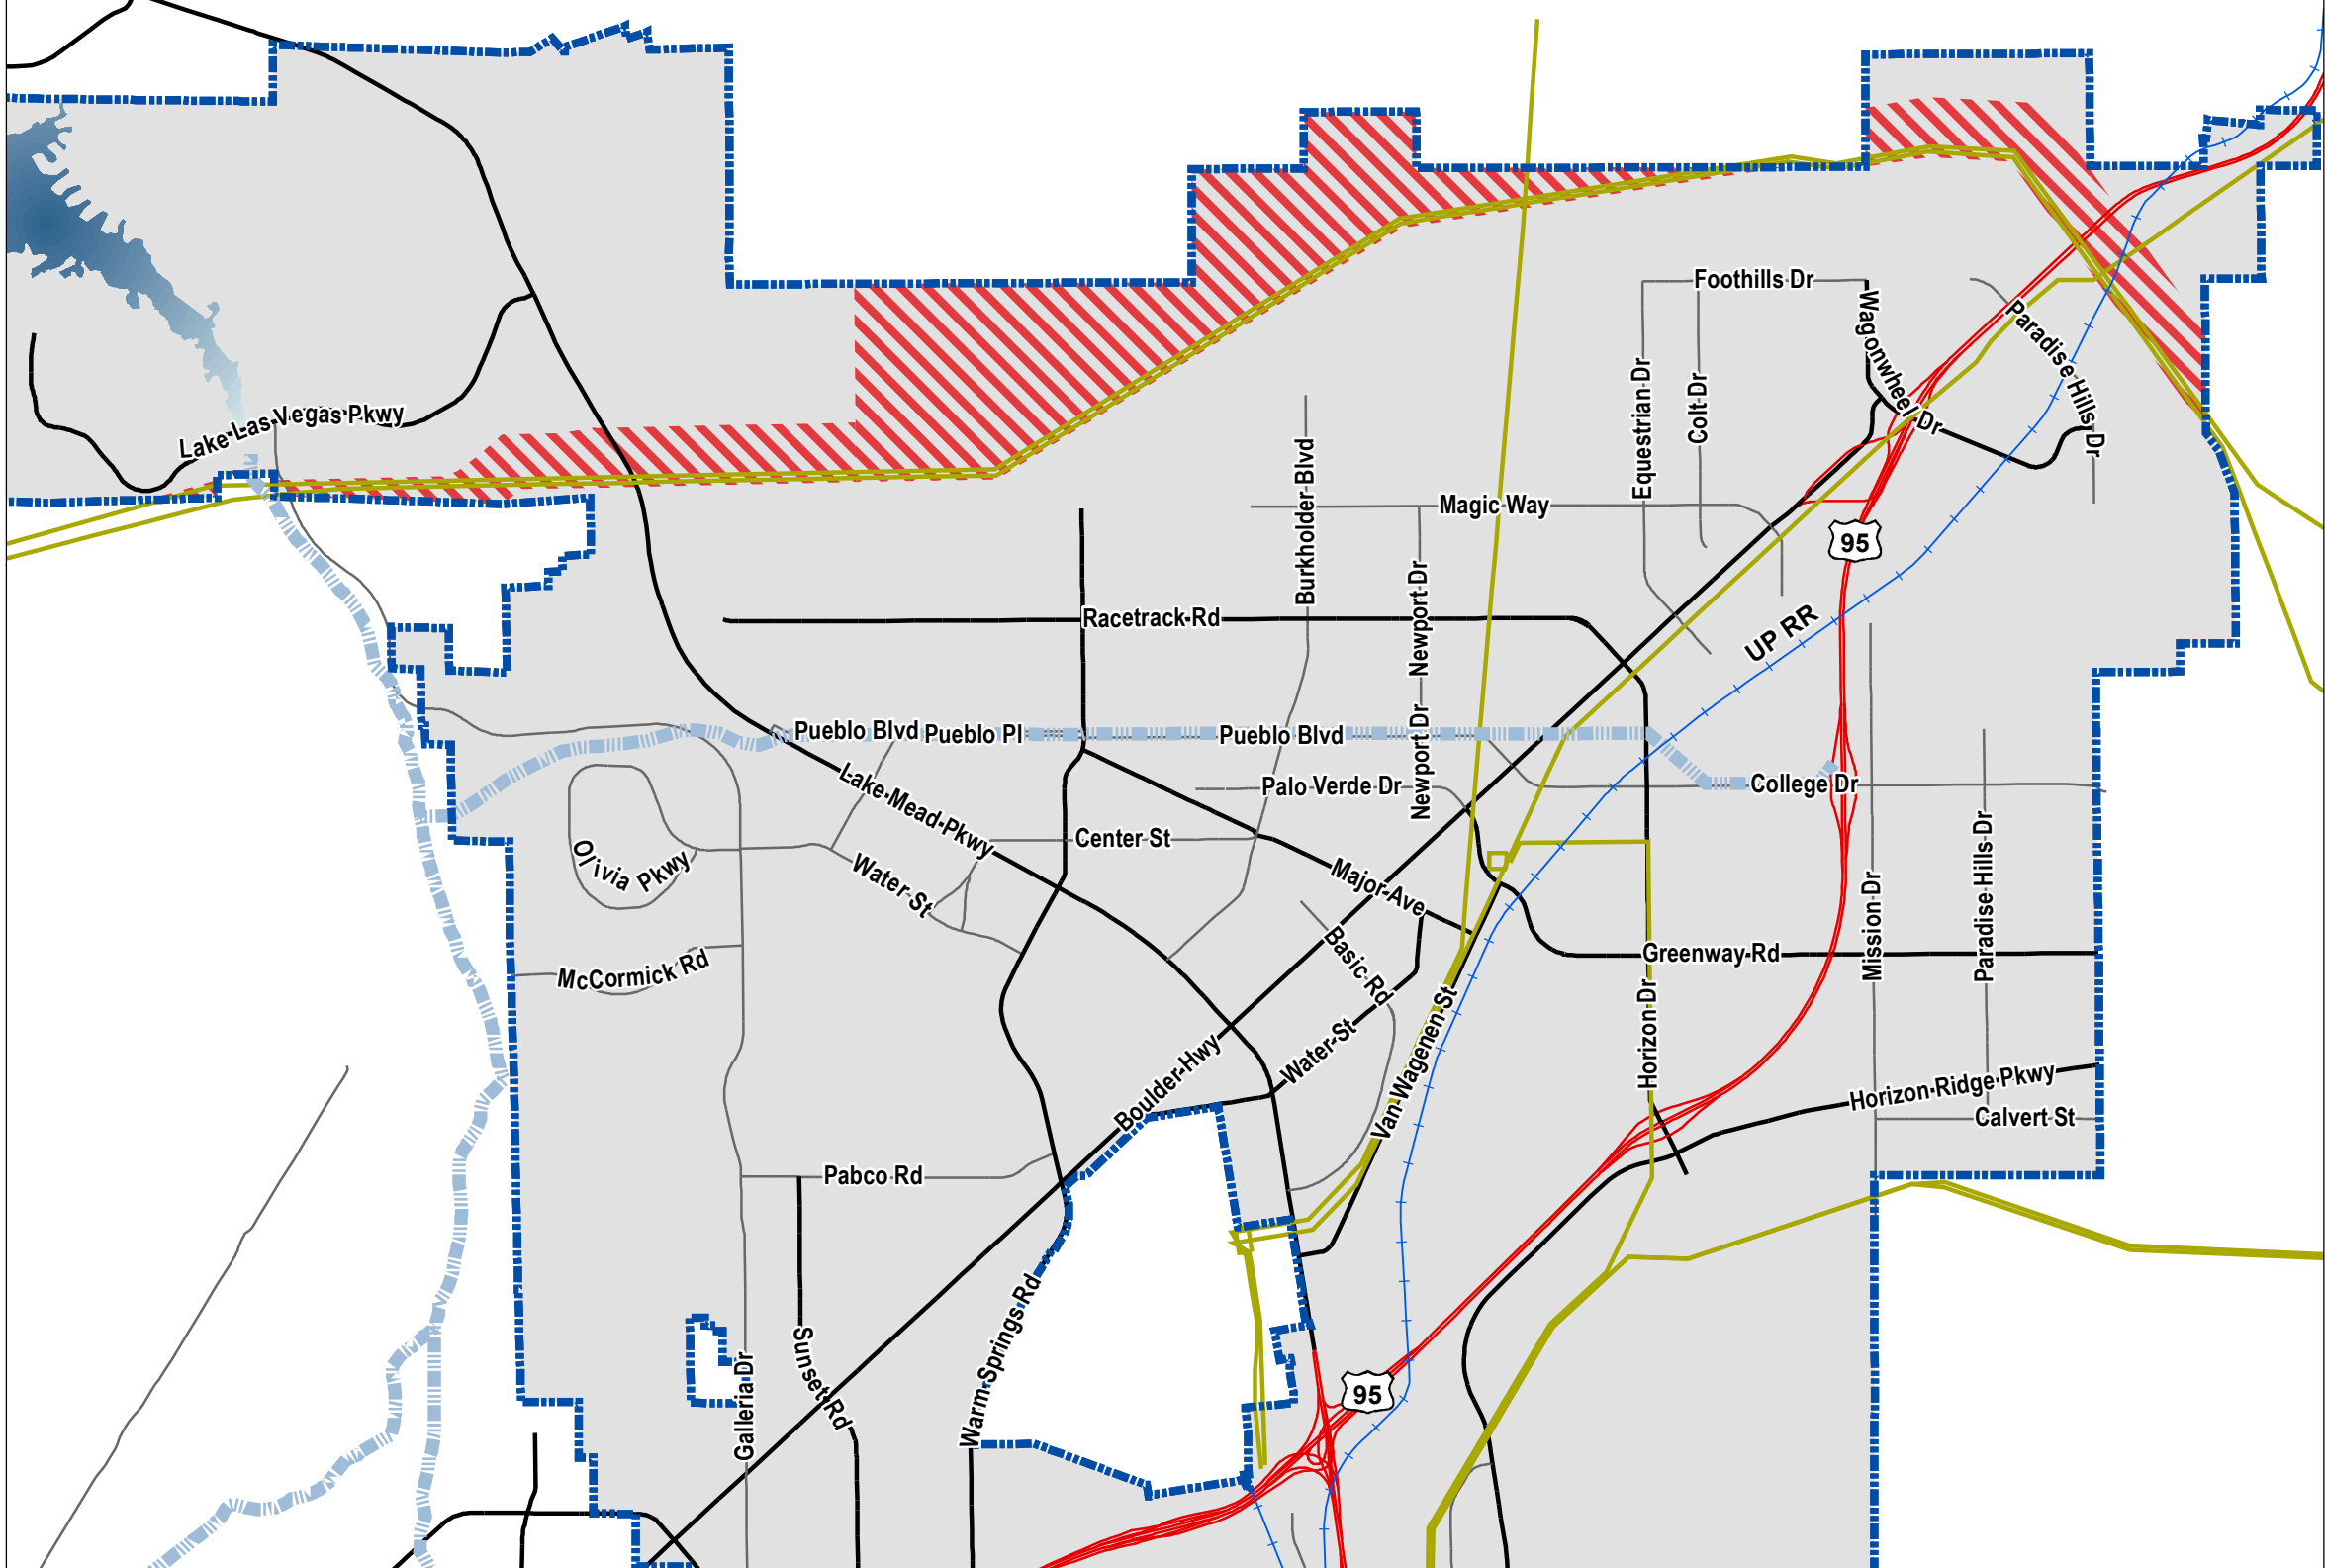

P:\projects\cd\11\2016\CompPlanUpdate\mxds_2\CompPlanUpdate_AboveGroundUtilityCorridor.mxd